



Level



Pressure



Flow



Temperature

Liquid
Analysis

Registration

Systems
Components

Services



Solutions

Technical Information

Prosonic S

FDU91/91F/92/93/95/96

Ultrasonic sensors for non-contact continuous level and flow measurement;
for connection to the transmitter FMU90



Application

- Continuous, non-contact level measurement of fluids, pastes, sludges and powdery to coarse bulk materials
- Flow measurement in open channels and measuring weirs
- Maximum measuring range
 - FDU91/FDU91F:
 - 33 ft (10 m) in fluids
 - 16 ft (5 m) in bulk materials
 - FDU92:
 - 65 ft (20 m) in fluids
 - 33 ft (10 m) in bulk materials
 - FDU93:
 - 85 ft (25 m) in fluids
 - 50 ft (15 m) in bulk materials
 - FDU95:
 - 148 ft (45 m) in bulk materials
 - FDU96:
 - 230 ft (70 m) in bulk materials
- Suited for explosion hazardous areas

Your benefits


- Non-contact measurement method; minimizes service requirements
- Integrated temperature sensor for time-of-flight correction. Accurate measurements are possible, even if temperature changes are present
- Hermetically welded PVDF sensors FDU91/92 for fluid measurement; for highest chemical resistance
- Integrated automatic sensor detection for transmitters FMU90; simple commissioning
- Can be installed up to 1000 ft (300 m) from the transmitter
- Suited for rough ambient conditions thanks to separate installation from the transmitter
- Reduced build-up formation because of the self-cleaning effect
- Integrated heating against a build-up of ice at the sensor (optional); ensures reliable measurement
- Weather resistant and flood-proof (NEMA 6P/IP68)
- Dust-Ex and Gas-Ex certificates available (ATEX, FM, CSA)

Table of Contents

Function and system design	3	Ex approval	17
Measuring principle	3	External standards and guidelines	17
Time-of-flight correction	3		
Blocking distance	3	Ordering information	17
Transmitter	3	Product structure FDU91	17
		Product structure FDU91F	18
Input	4	Product structure FDU92	18
Measuring range	4	Product structure FDU93	19
Operating frequency	5	Product structure FDU95	19
		Product structure FDU96	20
Output	5	Scope of delivery	20
Signal transmission	5		
		Accessories	20
Auxiliary energy	5	Extension cable for sensors	20
Power supply	5	Protective cover for FDU91	21
Sensor heater (for FDU91)	5	Flanges	21
		Cantilever	21
Electrical connection	6	Mounting Frame	22
Connection diagram	6	Wall Bracket	22
Connection hints	7	Alignment unit FAU40	23
Connection of the sensor heater (for FDU91F)	7		
Extension cables for the sensors	7	Supplementary documentation	23
Shortening the sensor cable	8	Innovation booklet	23
		Technical Information	23
Installation conditions	9	Operating instructions (for transmitter FMU90)	23
Installation options (Examples)	9	Description of Instrument Functions (for transmitter FMU90)	24
Installation conditions for level measurements	10	Safety Instructions	24
Installation conditions for flow measurements	11		
Flush mounting with slip-on flange FAU80	12		
Nozzle installation	13		
Ultrasound guide pipe	13		
Ambient conditions	13		
Ingress protection	13		
Vibration resistance	13		
Storage temperature	13		
Thermal shock resistance	13		
Electromagnetic compatibility	13		
Process conditions	14		
Process temperature / Process pressure	14		
Mechanical construction	14		
Dimensions FDU91	14		
Dimensions FDU91F	14		
Dimensions FDU92	15		
Dimensions FDU93	15		
Dimensions FDU95	15		
Dimensions FDU96	16		
Weight	16		
Materials	16		
Connecting cable	16		
Certificates and Approvals	17		
CE mark	17		

Function and system design

Measuring principle

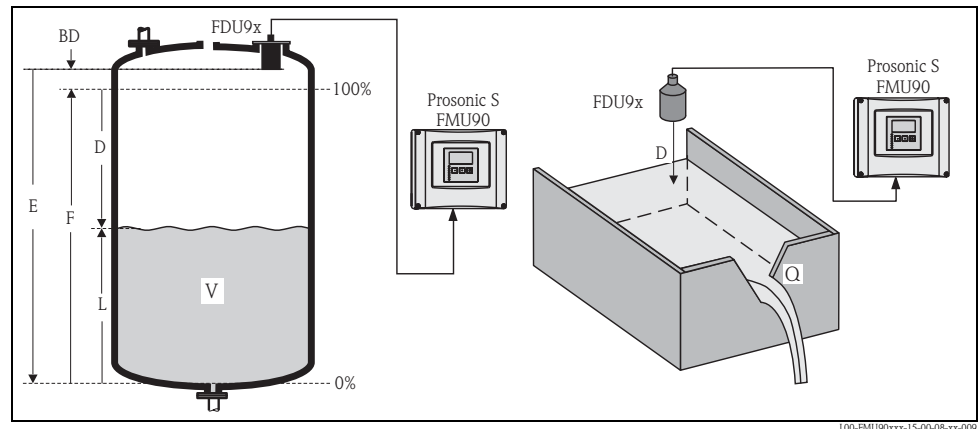

BD: blocking distance; **D:** distance from sensor membrane to fluid surface; **E:** empty distance **F:** span (full distance); **L:** level; **V:** volume (or mass); **Q:** flow

The sensor transmits ultrasonic pulses in the direction of the product surface. There, they are reflected back and received by the sensor. The transmitter Prosonic S measures the time t between pulse transmission and reception. From t (and the velocity of sound c) it calculates the distance D from the sensor membrane to the product surface:

$$D = c \cdot t / 2$$

From D results the desired measuring value:

- level L
- volume V
- flow Q across measuring weirs or open channels

Time-of-flight correction

In order to compensate for temperature dependent time-of-flight changes, a temperature sensor is integrated in the ultrasonic sensors.

Blocking distance

The level L may not extend into the blocking distance BD . Level echoes within the blocking distance can not be evaluated due to the transient characteristics of the sensor and thus a reliable measurement is not possible. The blocking distance BD is dependent on the type of sensor:

Type of sensor	Blocking distance (BD)
FDU91/FDU91F	1 ft (0.3 m)
FDU92	1.3 ft (0.4 m)
FDU93	2 ft (0.6 m)
FDU95 - *1*** (low temperature version)	2.3 ft (0.7 m)
FDU95 - *2*** (high temperature version)	3 ft (0.9 m)
FDU96	5 ft (1.6 m)

Transmitter

The sensors can be connected to the transmitter FMU90. The transmitter recognizes the type of sensor automatically.


Input

Measuring range

The effective range of the sensors is dependent on the operating conditions. To estimate the range, proceed as follows (see also the example):

1. Determine which of the influences shown in the following table are appropriate for your process.
2. Add the corresponding attenuation values.
3. From the total attenuation, use the diagram to calculate the range.

Fluid surface	Attenuation
calm	0 dB
waves	5 to 10 dB
strong turbulence (e.g. stirrers)	10 to 20 dB
foaming	ask Endress+Hauser
Bulk material surface	Attenuation
hard, rough (e.g. rubble)	40 dB
soft (e.g. peat, dust-covered clinker)	40 to 60 dB
Dust	Attenuation
no dust formation	0 dB
little dust formation	5 dB
heavy dust formation	5 to 20 dB
Filling curtain in detection range	Attenuation
none	0 dB
small quantities	5 dB
large quantities	5 to 20 dB
Temperature difference between sensor and product surface	Attenuation
to 68°F (20°C)	0 dB
to 104°F (40°C)	5 to 10 dB
to 176°F (80°C)	10 to 20 dB

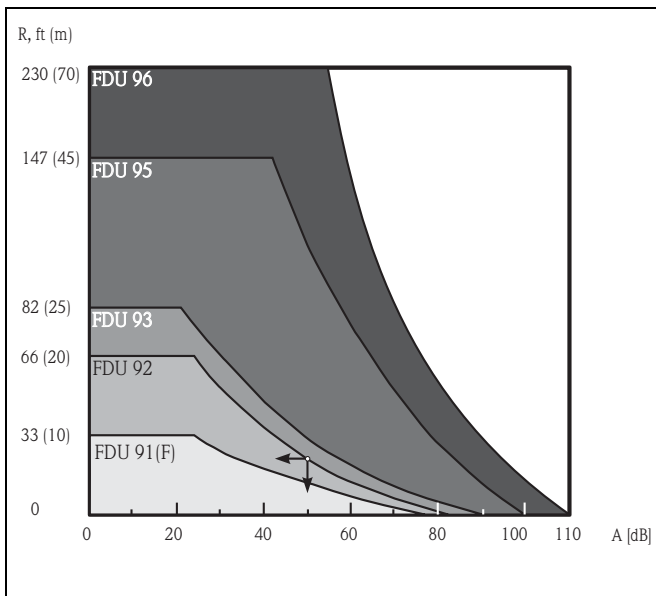

A: Attenuation (dB); R: Range ft (m)

Example

- Silo with rubble: ~ 40dB
 - small quantities of filling curtain: ~ 5dB
 - little dust: ~ 5dB
- total: ~ 50dB
- => Range approx. 26 ft (8 m) for FDU92

Operating frequency

Sensor	Operating frequency
FDU91	43 kHz
FDU91F	42 kHz
FDU92	30 kHz
FDU93	27 kHz
FDU95 - *1*** (low temperature version)	17 kHz
FDU95 - *2*** (high temperature version)	18 kHz
FDU96	11 kHz

Output

Signal transmission Analog voltages

Auxiliary energy

Power supply Supplied by the transmitter FMU90

Sensor heater (for FDU91) The FDU91 sensor is available in a version with heater. The power for this heater must be provided by an external power supply unit. The supply voltage is connected to the brown (BN) and blue (BU) wires of the sensor cable.

Technical data


- 24 VDC \pm 10%; residual ripple < 100 mV
- 250 mA per sensor

**NOTE!**

For the FDU91 with sensor heater, the integrated temperature sensor can not be used. Instead, an external temperature sensor (Pt100 or FMT131 from Endress+Hauser) must be used. The transmitter FMU90 is available in a version with an input for the external temperature sensor. For details refer to Technical Information TI397F.

Electrical connection

Connection diagram

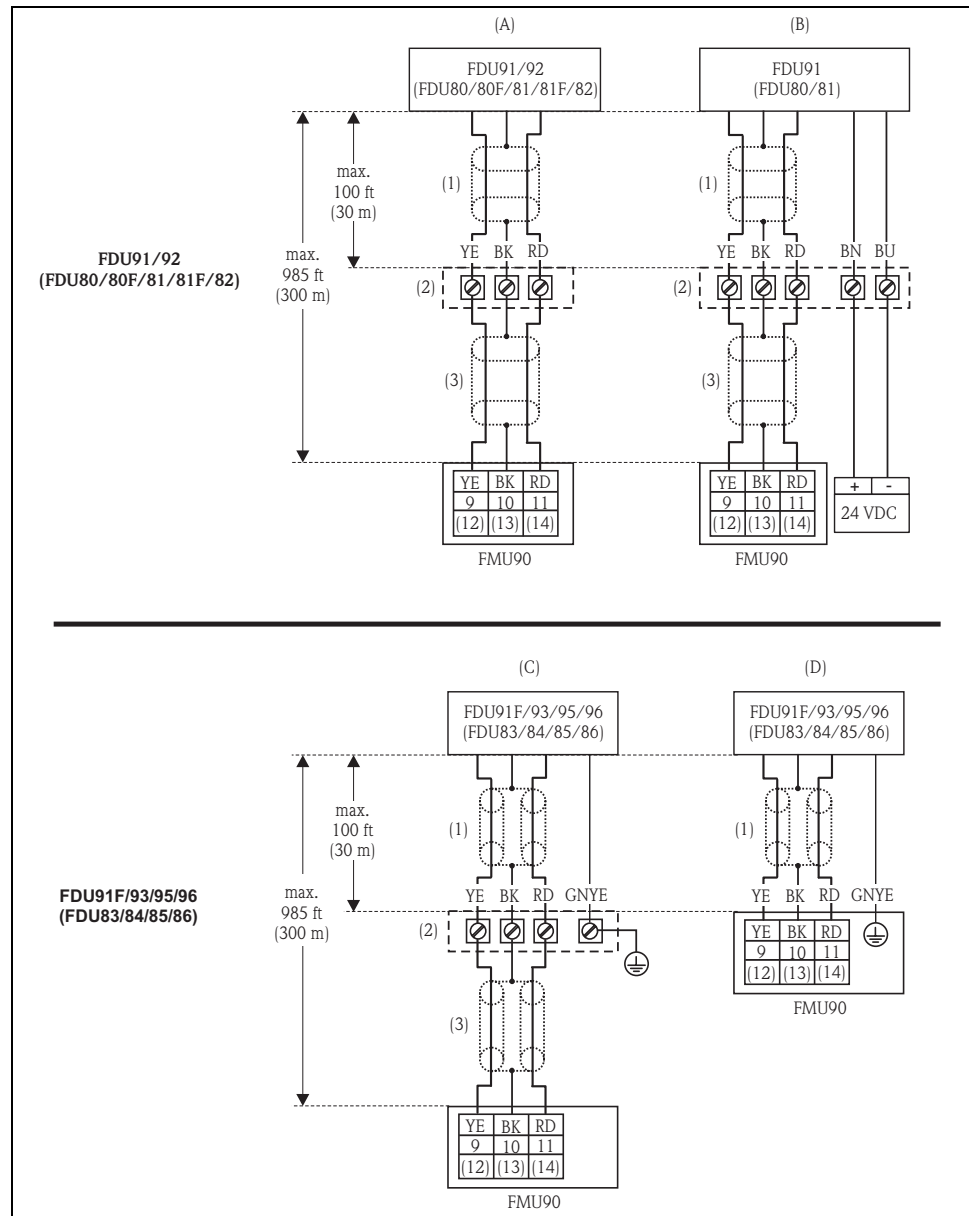

100-FDU9xxxx-04-00-00-zz-002

- (A): without sensor heater;
 - (B): with sensor heater;
 - (C): grounding at the terminal box;
 - (D): grounding at the transmitter FMU90;
 - (1): Shield of the sensor cable;
 - (2): Terminal box;
 - (3): Shield of the extension cable;
- Wire colors: YE = yellow; BK = black; RD = red; BU = blue; BN = brown; GNYE = green-yellow

Connection hints
**Caution!**

In order to avoid interference signals, the sensor cables should not be laid parallel to high voltage electric power lines. The cables may not be laid in the proximity to frequency converters.

**Caution!**

The cable shield serves as a return cable and must be connected to the transmitter without any electrical break. With the pre-assembled cables, the shield ends in a black strand (BK). With the extension cable, the shield must be twisted together and connected to the "BK" terminal.

**Warning!**

The sensors FDU83, FDU84, FDU85 and FDU86 with an ATEX, FM or CSA certificate are not certified for connection to the FMU90 transmitter.

**Warning!**

For the sensors FDU91F/93/95/96 and FDU83/84/85/86:

The ground lead (GNYE) must be connected to the local potential equalization **after a maximum distance of 100 ft (30 m)**. This can be done:

- either at the terminal box
- or at the transmitter FMU90 or in the cabinet (if the distance to the sensor does not exceed 100 ft / 30 m).

**Note!**

For easier mounting, it is advisable to use the sensors FDU91/92 and FDU80/80F/81/81F/82 with a maximum cable length of 100 ft (30 m) as well. For longer distances an extension cable with a terminal box should be used.

Connection of the sensor heater (for FDU91F)

The FDU91 sensor is available in a version with heater. The power for this heater must be provided by an external power supply unit. The supply voltage is connected to the brown (BN) and blue (BU) wires of the sensor cable.

Technical Data

- 24 VDC \pm 10%; residual ripple < 100 mV
- 250 mA per sensor

Extension cables for the sensors

For distances up to 100 ft (30 m) the sensor can be directly connected by the sensor cable. For longer distances, it is recommended to use an extension cable. The extension cable is connected via a terminal box. The total length (sensor cable + extension cable) may be up to 1000 ft (300 m).

**Caution!**

If the terminal box is installed in explosion hazardous areas, all applicable national guidelines must be observed.

Suitable extension cables can be obtained from Endress+Hauser (s. chapter "Accessories")

Alternatively, cables with the following properties can be used:

- Number of cores according to the connection diagram (see above)
- Braided wire shield for the yellow (YE) and red (RD) core (no foil shield)
- Length: up to 1000 ft (300 m), sensor cable + extension cable
- Cross section: 16 to 18 AWG (0.75 mm² to 2.5 mm²)
- Up to 6 Ω per core
- Max. 60 nF
- For FDU91F/93/95/96 and FDU 83/84/85/86:
The ground lead must not be within the shielding.

Shortening the sensor cable


If required, the sensor cable can be shortened. Please note:

- Do not damage the wires when removing the insulation.
- The cable is shielded by a metallic braiding. This shielding serves as a return cable and corresponds to the black (BK) strand of the unshortened cable. After shortening the cable, loosen the metallic braiding, twist it together securely and connect it to the "BK" terminal.



Caution!

The protective ground conductor (GNYE), which is present in some of the sensor cables, may not be electrically connected to the cable shield.

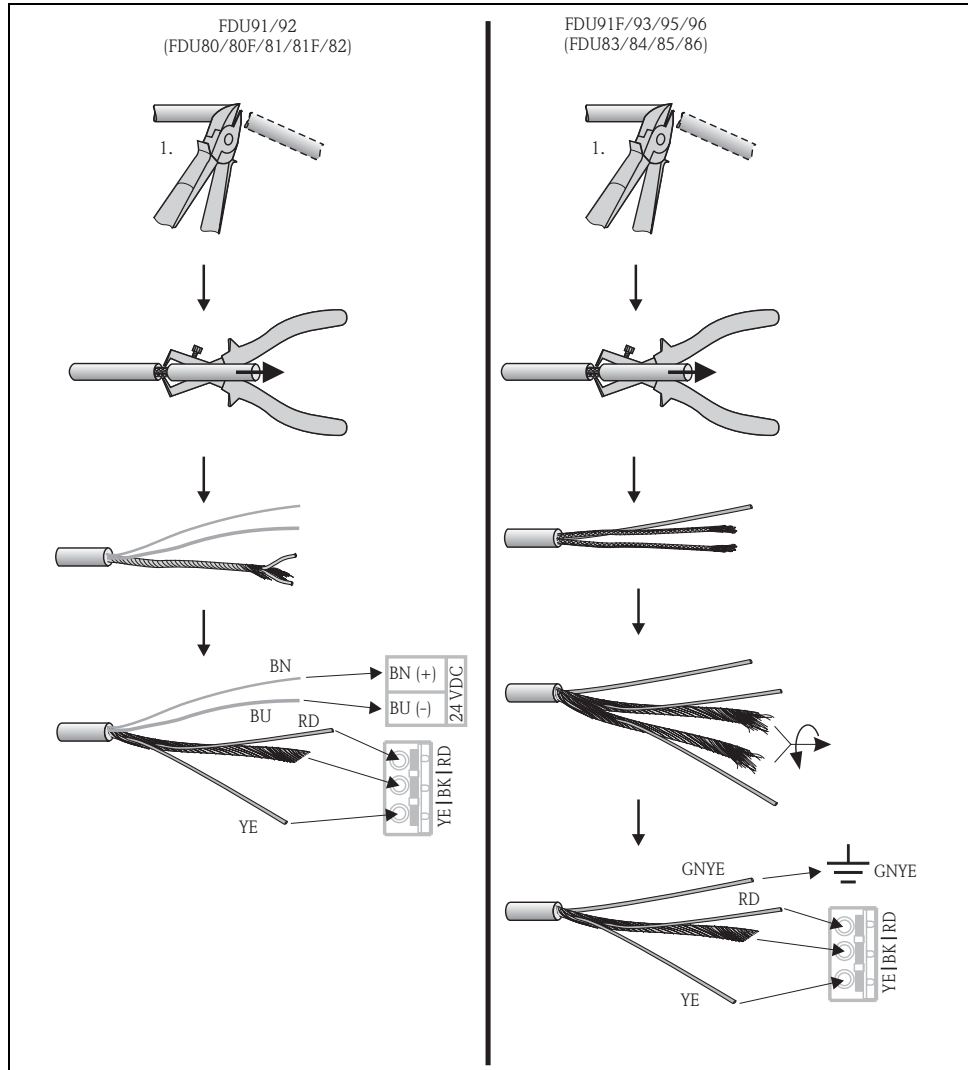

L00-FMU90xxx-04-00-00-xx-015

Colors of the strands: YE = yellow; BK = black; RD = red; BU = blue; BN = brown; GNYE = green-yellow




Note!


The blue (BU) and brown (BN) wires are only present for sensors with heater.

Installation conditions

Installation options (Examples)

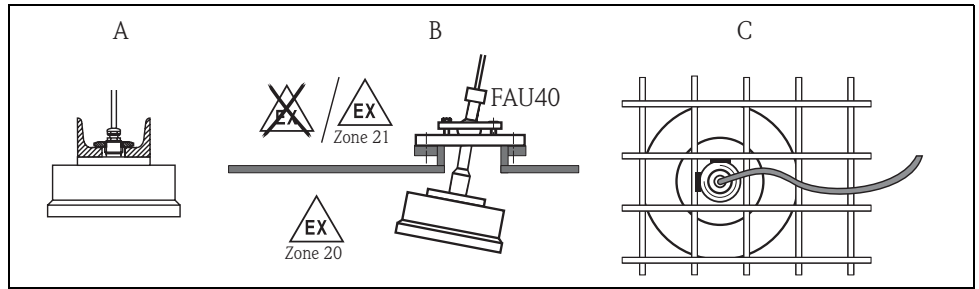

A: at girder or angle bracket; **B:** with alignment unit FAU40; in ATEX Zone 20 the alignment unit can be used for zone separation; **C:** with a 1" sleeve welded to a grating

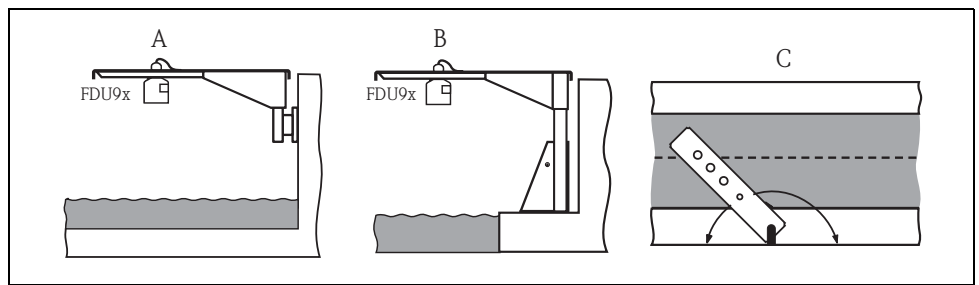

A: Installation with cantilever and wall bracket; **B:** Installation with cantilever and mounting frame; **C:** The cantilever can be turned in order to position the sensor over the center of the flume.

Cantilever, wall bracket and mounting frame are available as accessories (see chapter "Accessories").



Caution!


The cable of the sensors is not designed as a supporting cable. Do not use it as a suspension wire.



Caution!

The sensor membrane is part of the measuring system and must not be damaged during installation.

Installation conditions for level measurements

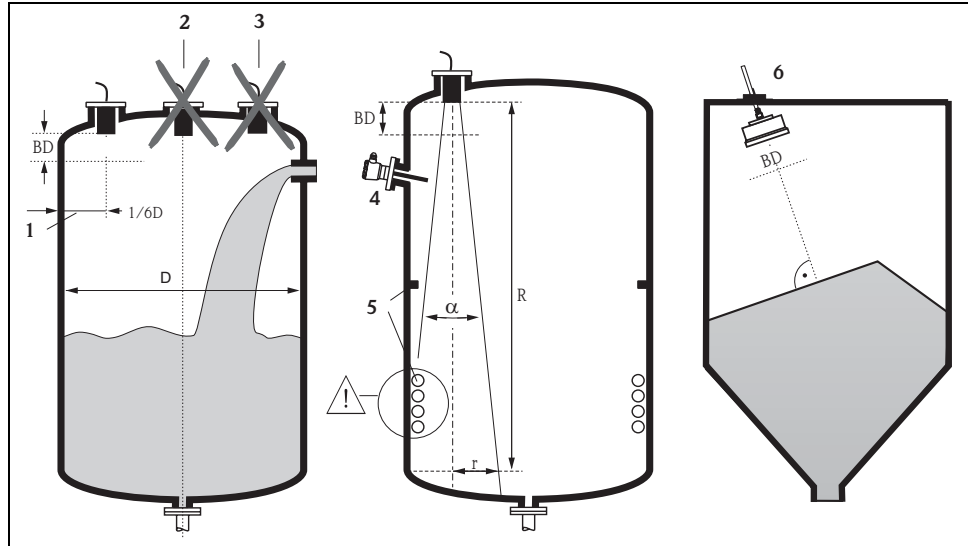

L00-FDU9xxxx-17-00-00-zx-003

- If possible, install the sensor so that its lower edge projects into the vessel.
- Make sure that the maximum level does not reach into the blocking distance (BD, see table).
- Do not install the sensor in the middle of the tank (2). We recommend leaving a distance (1) between the sensor and the tank wall measuring 1/6 of the tank diameter.
- Avoid measurements through the filling curtain (3).
- Make sure that equipment (4) such as limit switches, temperature sensors, baffles etc. are not located within the emitting angle α . Emitting angles of the individual sensors are given in the table below. In particular, symmetrical equipment (5) such as heating coils etc. can influence the measurement.
- Align the sensor vertically to the product surface (6). An alignment unit (FAU40) is available as an accessory (see chapter "Accessories").
- If the two-channel version of the transmitter FMU90 is used, both sensors can be mounted in one vessel.
- To estimate the detection range, use the 3 dB emitting angle α :

Sensor	Blocking distance BD	α (typically)	Application	L (max)	r (max)
FDU91	1 ft (0.3 m)	9°	fluids	33 ft (10 m)	2.6 ft (0.79 m)
			bulk materials	16 ft (5 m)	1.3 ft (0.39 m)
FDU91F	1 ft (0.3 m)	12°	fluids	33 ft (10 m)	3.4 ft (1.05 m)
			bulk materials	16 ft (5 m)	1.7 ft (0.53 m)
FDU92	1.3 ft (0.4 m)	11°	fluids	65 ft (20 m)	6.3 ft (1.92 m)
			bulk materials	33 ft (10 m)	3 ft (0.96 m)
FDU93	2 ft (0.6 m)	4°	fluids	82 ft (25 m)	2.8 ft (0.87 m)
			bulk materials	50 ft (15 m)	1.7 ft (0.52 m)
FDU95	<ul style="list-style-type: none"> ■ 2 ft / 0.7 m (low temperature version) ■ 3 ft / 0.9 m (high temperature version) 	5°	bulk materials	147 ft (45 m)	6.4 ft (1.96 m)
FDU96	5 ft (1.6 m)	6°	bulk materials	230 ft (70 m)	12 ft (3.6 m)




Warning!
All national guidelines applicable must be observed in explosion hazardous areas.

Installation conditions for flow measurements


- Install the sensor at the inflow side (A), above the maximum water level H_{max} plus the blocking distance BD.
- Position the sensor in the middle of the channel or weir.
- Align the sensor vertically to the water surface.
- Comply to the installation distance of the channel or weir.¹⁾
- Use a protective cover, in order to protect the sensor from direct sun or rain. A protective cover is available for the sensor FDU91 (see chapter "Accessories").

Example: Khafagi-Venturi flume

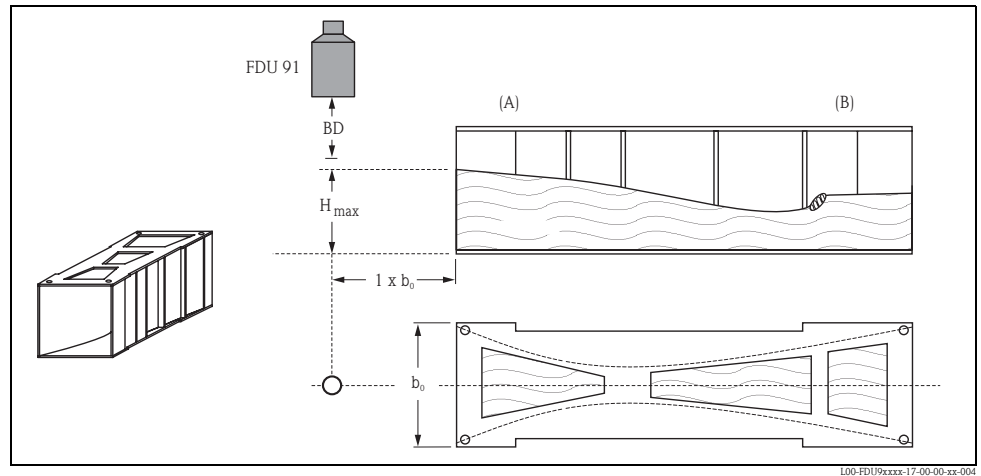

(A): inflow side; (B): outflow side


Example: V-notch weir

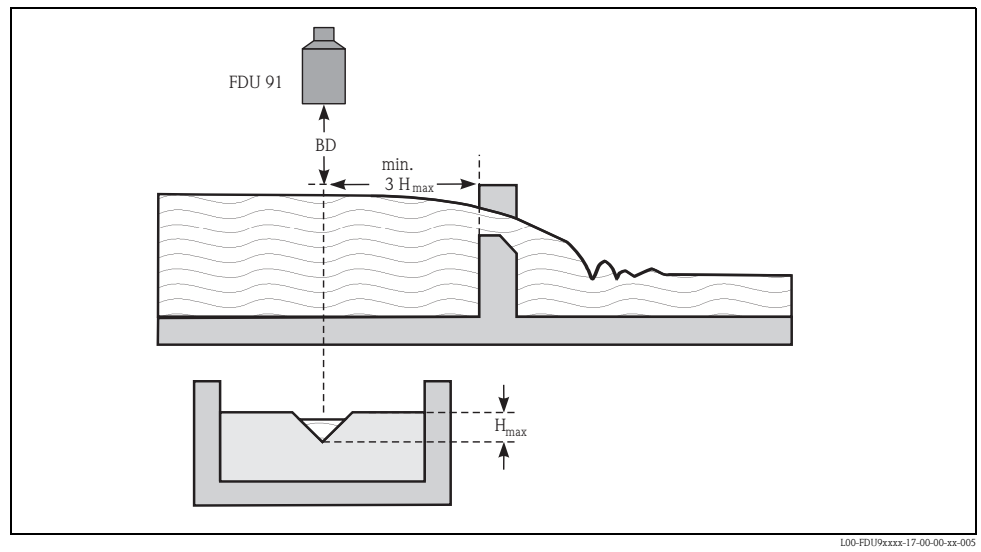

1) The installation distances of important flumes and weirs are specified in the Operating Instructions BA 289F (FMU90 with HART) and BA 293F (FMU90 with PROFIBUS).


Flush mounting with slip-on flange FAU80

The FDU91F sensor can be flush mounted using a FAU80 slip-on flange. Flanges in polypropylene (PPs) should only be used with pressures up to 22 psia (1.5 bar_{abs}), flanges in 316L SS also above.

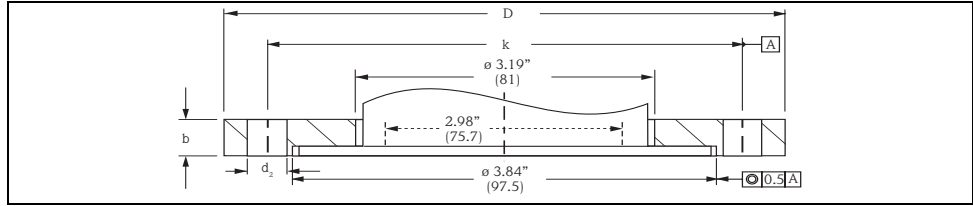

L00-FDU9xxxx-17-00-00-xx-009

Order No.	Material	b, in (mm)	ØD, in (mm)	Ød2, in (mm)	k, in (mm)	No. d2	Standard
FAU80 - CAP	PPs	0.79 (20)	7.87 (200)	0.71 (18)	6.30 (160)	8	DN80 PN16 (DIN EN 1092-1-E)
FAU80 - CAJ	316L						
FAU80 - AAP	PPs	0.94 (23.9)	7.50 (190.5)	0.75 (19.1)	6.00 (152.4)	4	ANSI 3" 150 psi (ANSI B 16.5)
FAU80 - AAJ	316L						
FAU80 - KAP	PPs	0.71 (18)	7.28 (185)	0.75 (19)	5.90 (150)	8	JIS10 K80 (JIS B 2220)
FAU80 - KAJ	316L						

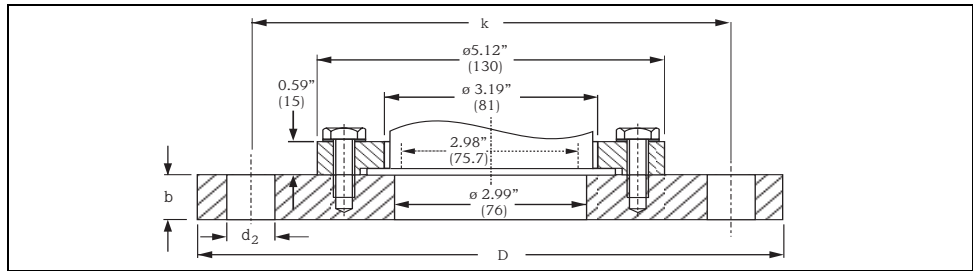

L00-FDU9xxxx-17-00-00-xx-010

Order No.	Material	b, in (mm)	ØD, in (mm)	Ød2, in (mm)	k, in (mm)	No. d2	Standard
FAU80 - CHP	PPs	0.79 (20)	7.87 (220)	0.71 (18)	7.09 (180)	8	DN100 PN16 (DIN 2527)
FAU80 - CHJ	316L						
FAU80 - AHP	PPs	0.94 (23.9)	9.00 (228.6)	0.75 (19.1)	7.50 (190.5)	4	ANSI 4" 150 psi (ANSI B 16.5)
FAU80 - AHJ	316L						
FAU80 - KHP	PPs	0.71 (18)	8.27 (210)	0.75 (19)	6.89 (175)	8	JIS10 K100 (JIS B 2220)
FAU80 - KHJ	316L						




Caution!

For 3-A applications:

The internal diameter of the nozzle should be selected according to the valid allowable limits for 3-A applications. Usually, the internal diameter of the nozzle should be larger than or equal to the internal diameter of the sensor.

Nozzle installation

Install the sensor at a height so that the blocking distance BD is not undershot, even at maximum fill level. Use a pipe nozzle if you cannot maintain the blocking distance in any other way. The interior of the nozzle must be smooth and may not contain any edges or welded joints. In particular, there should be no burr on the inside of the tank side nozzle end. Note the specified limits for nozzle diameter and length. To minimize disturbing factors, we recommend an angled socket edge (ideally 45°).

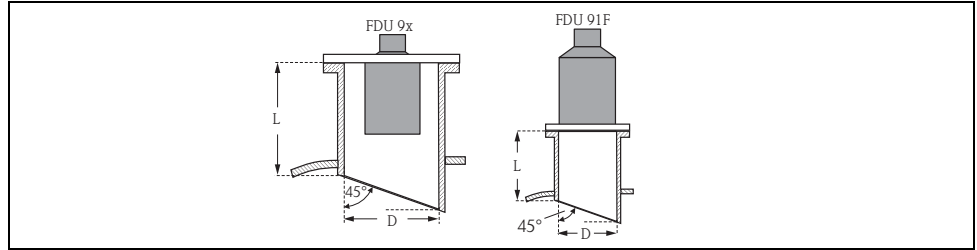


L00-FDU9xxx-17-00-00-xx-006

Sensor	D inches (mm)	L inches (mm)
FDU91	3.15 (80)	< 13.4 (340)
	3.94 (100)	< 15.4 (390)
FDU91F	3.15 (80)	< 9.84 (250)
	3.94 (100)	< 11.8 (300)
FDU92	5.91 (150)	< 15.7 (400)
FDU93	7.87 (200)	< 20.5 (520)
FDU95	9.84 (250)	< 24.8 (630)
FDU96	11.8 (300)	< 31.5 (800)

Ultrasound guide pipe

In narrow shafts with strong interference echoes, we recommend using an ultrasound guide pipe (e.g. PE or PVC wastewater pipe) with a minimum diameter of 4" (100 mm), for FDU91. Make sure that the pipe is not soiled by accumulated dirt. If necessary, clean the pipe at regular intervals.

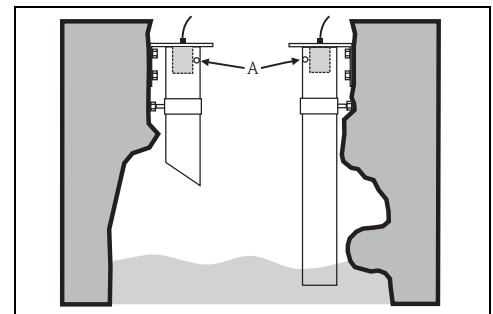

A: venting hole

Ambient conditions

Ingress protection

Tested according to IP68/NEMA6P (24 h at 6 ft under water surface)

Vibration resistance

DIN EN 600068-2-64; 20 ... 2000 Hz; 1 (m/s²)²/Hz; 3x100 min.

Storage temperature

Identical to process temperature, see below

Thermal shock resistance

According to DIN EN 60068-2-14; examination to min/max process temperature; 0.5 K/min; 1000 h

Electromagnetic compatibility

- Interference emission to EN 61326; Equipment class A
- Interference immunity to EN 61326; Appendix A (Industrial)

Process conditions


Process temperature
Process pressure

Sensor	Process temperature	Process pressure psia (bar _{abs})
FDU91	-40 to +176°F (-40 to +80 °C) ¹⁾	10 to 58 (0.7 to 4 bar)
FDU91F	-40 to +221°F (-40 to +105°C) (30 min/135 °C) ²⁾ for Ex instruments: -40 to +176°F (-40 to +80°C)	10 to 58 (0.7 to 4 bar)
FDU92	-40 to +203°F (-40 to +95°C) for Ex instruments: -40 to +176°F (-40 to +80°C)	10 to 58 (0.7 to 4 bar)
FDU93	-40 to +203°F (-40 to +95°C) for Ex instruments: -40 to +176°F (-40 to +80°C)	10 to 43 (0.7 to 3 bar)
FDU95 - *1*** (low temp. version)	-40 to +176°F (-40 to +80°C)	10 to 22 (0.7 to 1.5 bar)
FDU95 - *2*** (high temp. version)	-40 to +302°F (-40 to +150°C) for Dust-Ex versions: -40 to +266°F (-40 to 130°C)	10 to 22 (0.7 to 1.5 bar)
FDU96	-40 to +302°F (-40 to +150°C) for Dust-Ex or Gas-Ex versions: -40 to +284°F (-40 to 140°C)	10 to 43 (0.7 to 3 bar)

- 1) In order to avoid ice build-up, the sensor FDU91 is available in a version with integrated sensor heater (see page 5). If this heater is used, an external temperature sensor has to be applied for time-of-flight correction. The transmitter FMU90 is available in a version with an input for the external temperature sensor. For details refer to Technical Information TI397F.
- 2) Only valid for Tri-clamp and flush mounting

Mechanical construction

Dimensions FDU91

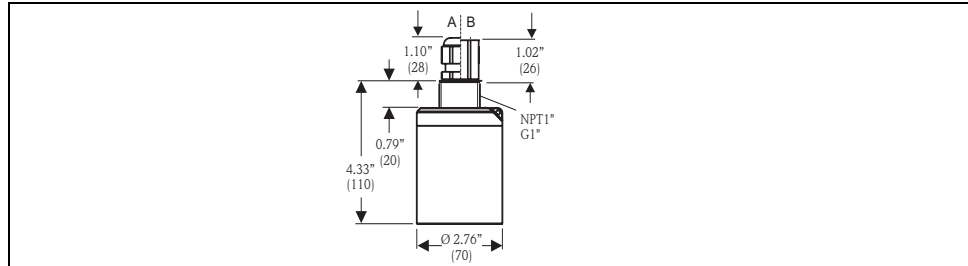


L00-FDU91xxx-06-00-00-zx-001

Dimensions in inches (mm)

A: Cable gland for: FDU91-R..., FDU91-J..., FDU91-G..., FDU91-E..., FDU91-H..., FDU91-U...

B: Conduit connection NPT 1/2" for: FDU91-S..., FDU91-Q... The conduit connection is partly potted (half filled).

Dimensions FDU91F

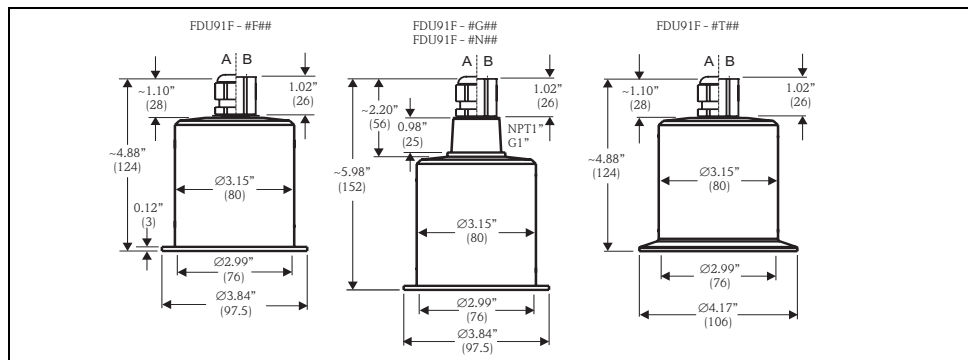


L00-FDU91Fxx-06-00-00-zx-001

Dimensions in inches (mm)

A: Cable gland for FDU91F-R..., FDU91F-J..., FDU91F-G..., FDU91F-E..., FDU91F-H..., FDU91F-U...

B: Conduit connection NPT 1/2" for: FDU91F-S..., FDU91F-Q... The conduit connection is partly potted (half filled).


Dimensions FDU92

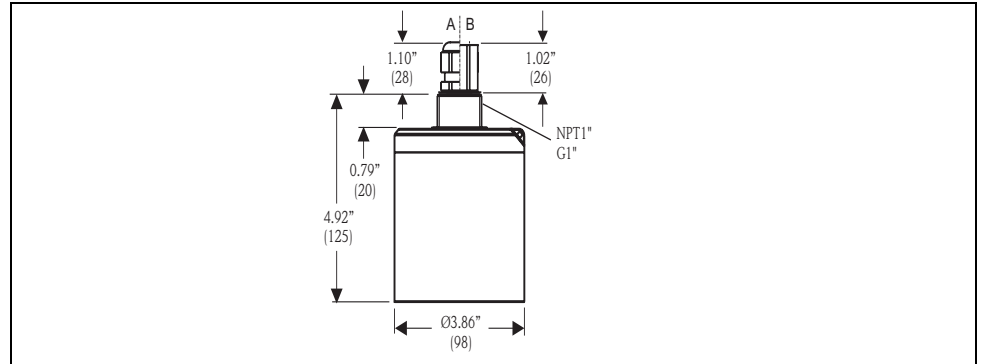

L00-FDU92xxx-06-00-00-xx-001

Dimensions in inches (mm)
A: Cable gland for: FDU92-R..., FDU92-J..., FDU92-G..., FDU92-E..., FDU92-H..., FDU92-U...
B: Conduit connection NPT 1/2" for: FDU92-S..., FDU92-Q...
 The conduit connection is partly potted (half filled).


Dimensions FDU93

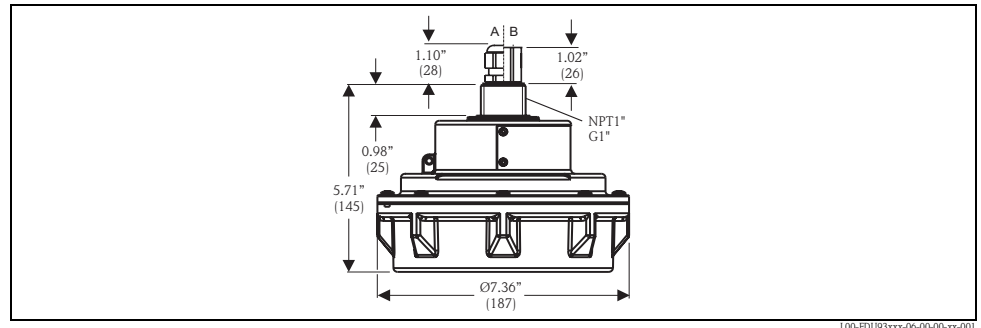

L00-FDU93xxx-06-00-00-xx-001

Dimensions in inches (mm)
A: Cable gland for: FDU93-R..., FDU93-J..., FDU93-G..., FDU93-E..., FDU93-H..., FDU93-U...
B: Conduit connection NPT 1/2" for: FDU93-T..., FDU93-P...
 The conduit connection is partly potted (half filled).


Dimensions FDU95

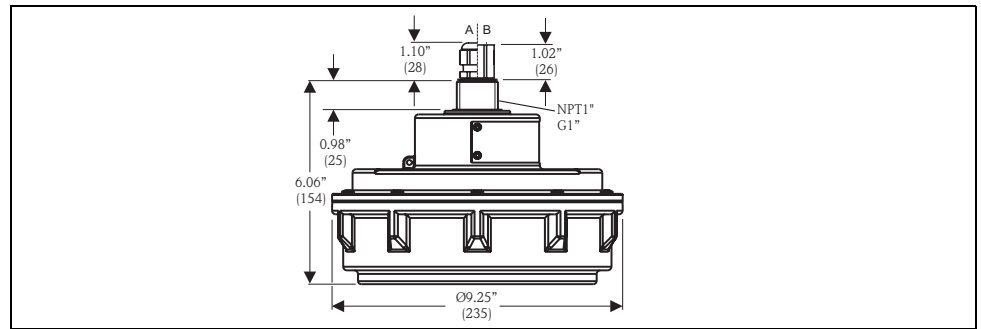

L00-FDU95xxx-06-00-00-xx-001

Dimensions in inches (mm)
A: Cable gland for: FDU95-R..., FDU95-J..., FDU95-E..., FDU95-H..., FDU95-U...
B: Conduit connection NPT 1/2" for: FDU95-P..., FDU95-T...
 The conduit connection is partly potted (half filled).

Dimensions FDU96

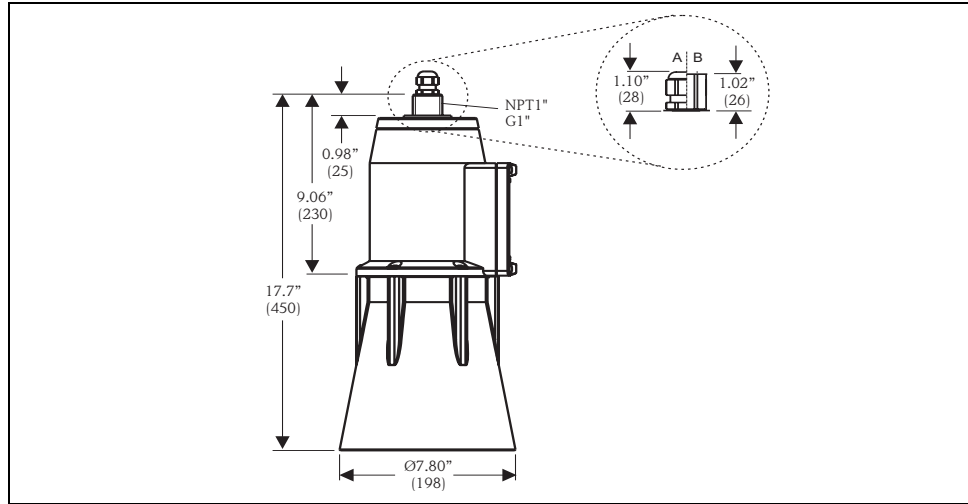

Dimensions in inches (mm)

A: Cable gland for: FDU95-R..., FDU95-J..., FDU95-E..., FDU95-H..., FDU95-U...

B: Conduit connection NPT 1/2" for: FDU95-P..., FDU95-T... The conduit connection is partly potted (half filled).

L00-FDU96xxx-06-00-00-xx-001

Weight

Sensor	Weight (including 16 ft / 5 m cable)
FDU91	approx. 2.4 lb (1.1 kg)
FDU91F	approx. 3.5 lb (1.6 kg)
FDU92	approx. 4.4 lb (2 kg)
FDU93	approx. 6.4 lb (2.9 kg)
FDU95	approx. 10 lb (4.5 kg)
FDU96	approx. 11 lb (5 kg)

Materials

Sensor	Material of sensor	Material of process connection	Material of process seal	Material of cable
FDU91	PVDF counter nut: PA	PVDF	w/o sealing	PVC
FDU91F	316L SS	316L	w/o sealing	PVC
FDU92	PVDF counter nut: PA	PVDF	w/o sealing	PVC
FDU93	<ul style="list-style-type: none"> ■ housing: UP ■ membrane: Alu/PTFE 	UP	silicone	PVC
FDU95 - *1*** (low temperature version)	<ul style="list-style-type: none"> ■ housing: UP ■ membrane coating: 316L SS/PE 	UP	silicone	PVC
FDU95 - *2*** (high temperature version)	<ul style="list-style-type: none"> ■ housing: UP ■ membrane coating: 316L SS 	UP	silicone	silicone
FDU96	<ul style="list-style-type: none"> ■ housing: UP ■ membrane coating: Alu/PTFE 	selectable: <ul style="list-style-type: none"> ■ UP ■ 304 SS 	silicone	silicone

Connecting cable

16 to 1000 ft (5 to 300 m)

For cable length > 100 ft (30 m), an extension cable is recommended.

In this case, the total length (sensor cable + extension cable) must not exceed 1000 ft (300 m).

Certificates and Approvals

CE mark	The measuring system meets the legal requirements of the EC-guidelines. Endress+Hauser confirms the instrument passing the required tests by attaching the CE-mark.
Ex approval	The available certificates are listed in the ordering information. Note the associated safety instructions (XA) and control or installation drawings (ZD).
External standards and guidelines	<p>EN 60529 Protection class of housing (IP code)</p> <p>EN 61326 Electromagnetic compatibility (EMC requirements)</p> <p>NAMUR Standards committee for measurement and control in the chemical industry</p>

Ordering information

Product structure FDU91

010	Approval				
	R	Non-hazardous area			
	J	ATEX II 2G EEx ma II T6			
	G	ATEX II 3G EEx nA II T6 (in preparation)			
	E	ATEX II 1/2 D, ATEX II 2G Ex ma II T6			
	H	ATEX II 3D (in preparation)			
	U	CSA General Purpose			
	S	CSA Cl.I,II,III Div.1+2 Gr.A-G			
	Q	FM Cl.I,II,III Div. 1+2 Gr.A-G			
	V	TIIS Ex is IIC T6 (in preparation)			
020	Process connection (threaded boss)				
	G	Thread ISO228 G1, PVDF			
	N	Thread ANSI 1" NPT, PVDF			
030	Cable length				
	1	5 m (16 ft)			
	2	10 m (33 ft)			
	3	15 m (50 ft)			
	4	20 m (66 ft)			
	5	25 m (82 ft)			
	6	30 m (100 ft)			
	8	... m (variable length, up to 300 m)			
	A	... ft (variable length, up to 985 ft)			
035	Heater				
	A	w/o heater			
	B	Connection to 24 VDC			
040	Additional option				
	A	Basic version			
FDU91 -					product designation

Product structure FDU91F

010	Approval	R	Non-hazardous area
		J	ATEX II 2G EEx ma II T5 (in preparation)
		G	ATEX II 3G EEx nA II T6 (in preparation)
		E	ATEX II 1/2 D, ATEX II 2G Ex ma II T6 (in preparation)
		H	ATEX II 3D (in preparation)
		U	CSA General Purpose
		S	CSA CL.I,II,III Div.1+2 Gr.A-G
		Q	FM CL.I,II,III Div. 1+2 Gr.A-G (in preparation)
		V	TIIS Ex is IIC T6 (in preparation)
020	Process connection	G	Thread ISO228 G1, 316L SS
		N	Thread ANSI 1" NPT, 316L SS
		F	Flush mounting; prepared for slip-on flange FAU80, 3-A
		T	Tri-Clamp ISO2852 DN80, 316L SS, 3-A
030	Cable length	1	5 m (16 ft)
		2	10 m (33 ft)
		3	15 m (50 ft)
		4	20 m (66 ft)
		5	25 m (82 ft)
		6	30 m (100 ft)
		8	... m (variable length, up to 300 m)
		A	... ft (variable length, up to 985 ft)
040	Additional option	A	Basic version
FDU91F -			product designation

Product structure FDU92

010	Approval	R	Non-hazardous area
		J	ATEX II 2G EEx m II T6
		G	ATEX II 3G EEx nA II T6 (in preparation)
		E	ATEX II 1/2 D, ATEX II 2G Ex ma II T6
		H	ATEX II 3D (in preparation)
		U	CSA General Purpose
		S	CSA CL.I,II,III Div.1+2 Gr.A-G
		Q	FM CL.I,II,III Div. 1+2 Gr.A-G
		V	TIIS Ex is IIC T6 (in preparation)
020	Process connection (threaded boss)	G	Thread ISO228 G1, PVDF
		N	Thread ANSI 1" NPT, PVDF
030	Cable length	1	5 m (16 ft)
		2	10 m (33 ft)
		3	15 m (50 ft)
		4	20 m (66 ft)
		5	25 m (82 ft)
		6	30 m (100 ft)
		8	... m (variable length, up to 300 m)
		A	... ft (variable length, up to 985 ft)
040	Additional option	A	Basic version
FDU92 -			product designation

Product structure FDU93

010	Approval	R	Non-hazardous area
		J	ATEX II 2G EEx m II T6, ATEX II 1/2D
		G	ATEX II 3G EEx nA II T6 (in preparation)
		E	ATEX II 1/2 D
		H	ATEX II 3D (in preparation)
		U	CSA General Purpose
		T	CSA Cl.I,II,III Div.1 Gr.E-G
		P	FM Cl.I,II,III Div. 1+2 Gr.A-G
		W	TIIS dust-Ex DP12 (in preparation)
020	Process connection (threaded boss)	G	Thread ISO228 G1, UP
		N	Thread ANSI 1" NPT, UP
030	Cable length	1	5 m (16 ft)
		2	10 m (33 ft)
		3	15 m (50 ft)
		4	20 m (66 ft)
		5	25 m (82 ft)
		6	30 m (100 ft)
		8	... m (variable length, up to 300 m)
		A	... ft (variable length, up to 985 ft)
040	Additional option	A	Basic version
FDU93 -			product designation

Product structure FDU95

010	Approval	R	Non-hazardous area
		J	ATEX II 2G Ex ma II T6, ATEX II 1/D
		E	ATEX II 1/2 D
		H	ATEX II 3D (in preparation)
		P	FM Cl.II Div.1 Gr.E-G
		U	CSA General Purpose
		T	CSA Cl.II Div.1 Gr.E-G
		W	TIIS dust-Ex DP12 (in preparation)
015	Temperature; blocking distance; material	1	-40 to +176°F (-40 to +80°C); 28" (70 cm); membrane: 316L SS; surface: PE
		2	-40 to + 302°F (-40 to 150°C); 35" (90 cm); membrane: 316L SS
020	Process connection (threaded boss)	G	Thread ISO228 G1, UP
		N	Thread ANSI 1" NPT, UP
030	Cable length	1	5 m (16 ft)
		2	10 m (33 ft)
		3	15 m (50 ft)
		4	20 m (66 ft)
		5	25 m (82 ft)
		6	30 m (100 ft)
		8	... m (variable length, up to 300 m)
		A	... ft (variable length, up to 985 ft)
040	Additional option	A	Basic version
FDU95 -			product designation

Product structure FDU96

010		Approval	
R		Non-hazardous area	
J		ATEX II 2G EEx ma II T6, ATEX II 1/2D	
E		ATEX II 1/2 D, -40 to +140°C	
F		ATEX II 1/2 D, -40 to +80°C	
H		ATEX II 3D (in preparation)	
U		CSA General Purpose	
L		CSA Cl.I,II,III Div.1 Gr.E-G; LT; Ambient temperature: -40 to +80°C (-40 to +176°F)	
T		CSA Cl.I,II,III Div.1 Gr.E-G; HT; Ambient temperature: -40 to +140°C (-40 to +284°F)	
P		FM Cl.I,II,III Div. 1+2 Gr.A-G; HT; Ambient temperature: -40 to +140°C (-40 to +284°F)	
K		FM Cl.I,II,III Div. 1+2 Gr.A-G; LT; Ambient temperature: -40 to +80°C (-40 to +176°F)	
W		TIIS dust-Ex DP12 (in preparation)	
020		Process connection (threaded boss)	
G		Thread ISO228 G1, UP	
S		Thread ISO228 G1, 304	
N		Thread ANSI 1" NPT, UP	
V		Thread ANSI 1" NPT, 304 SS	
030		Cable length	
	1	5 m (16 ft)	
	2	10 m (33 ft)	
	3	15 m (50 ft)	
	4	20 m (66 ft)	
	5	25 m (82 ft)	
	6	30 m (100 ft)	
	8	... m (variable length, up to 300 m)	
	A	... ft (variable length, up to 985 ft)	
040		Additional options	
	A	Basic version	
FDU96 -			product designation

Scope of delivery

- Instrument according to the version ordered
- This Technical Information TI396F (serves as installation and operating instruction)
- For certified instrument versions: Safety Instructions (XA) or Control Drawings (ZD)
- For FDU91 with sensor heater: terminal module, to be mounted in the field housing of the transmitter FMU90
- For FDU91/92: process seal (EPDM)
- For FDU91/92 with G1" process connection: counter nut (PA)
- For FDU 93/95/96 with Ex-certificate: process seal (silicone)

Accessories


Extension cable for sensors

for Sensor	Material	Cable type	Order code
<ul style="list-style-type: none"> ■ FDU91 ■ FDU92 	PVC	LiYCY/CUL 2x(0.75)	71027742
<ul style="list-style-type: none"> ■ FDU91F ■ FDU93 ■ FDU95 	PVC, -40 to +201°F (-40 to +105°C)	LIYY/CUL 2x(0,75)D+1x0.75#	71027743
<ul style="list-style-type: none"> ■ FDU95 ■ FDU96 	Silicone, -40 to +302°F (-40 to +150°C)	Li2G2G 2x(0,75)D+1x0.75#	71027745
<ul style="list-style-type: none"> ■ FDU91 with heater 	PVC	LIYY/CUL 2x(0,75)D+2x0.75#	71027746

Total length (sensor cable + extension cable): up to 1000 ft (300 m)

Protective cover for FDU91

- Material: PVDF
- Order code: 52025686

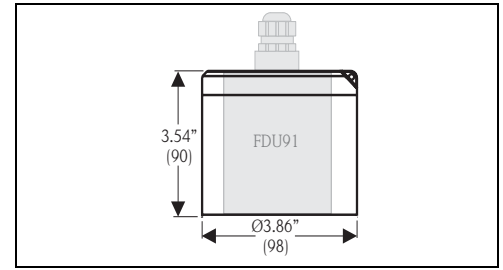

L00-FDU9xxxx-06-00-00-zz-003

Dimensions in inches (mm)


Flanges

Version	Material	Order code
DIN B DN80/PN16	PP-FR	919789-0000
DIN B DN100/PN16	PP-FR	919789-0002
DIN B DN150/PN16	PP-FR	919789-0004
DIN B DN200/PN16	PP-FR	919789-0006
DIN B DN250/PN16	PP-FR	919789-0008

All flanges have a central G1" thread (also suited for NPT 1"). The maximum operating pressure of the sensor is always valid.
Other flanges on request.

Cantilever

The cantilever is used to mount the sensor FDU91 above open channels for example.

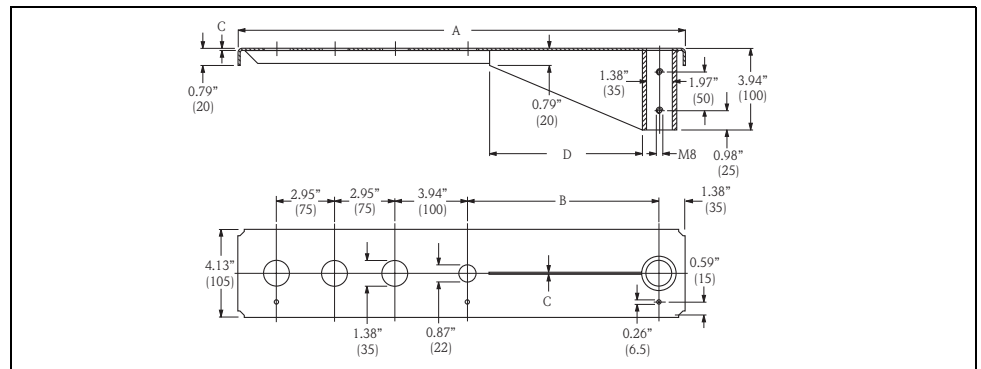

L00-FM14xxxx-06-00-00-yy-005


A	B	C	D	Material	Order code
23" (585 mm)	9.84" (250 mm)	0.08" (2 mm)	7.87" (200 mm)	galvanized steel	919790-0000
				316Ti/1.4571 SS	919790-0001
42.7" (1085 mm)	29.5" (750 mm)	0.12" (3 mm)	11.8" (300 mm)	galvanized steel	919790-0002
				316Ti/1.4571 SS	919790-0003

- The 1.38" (35 mm) orifices are for the sensors FDU9x.
- The 0.87" (22 mm) orifice may be used for an external temperature sensor (e.g. FMT131).

The cantilever can be mounted in the following ways:

- by a mounting frame (see below)
- by a wall bracket (see following page)
Mounting screws are supplied.


Mounting Frame

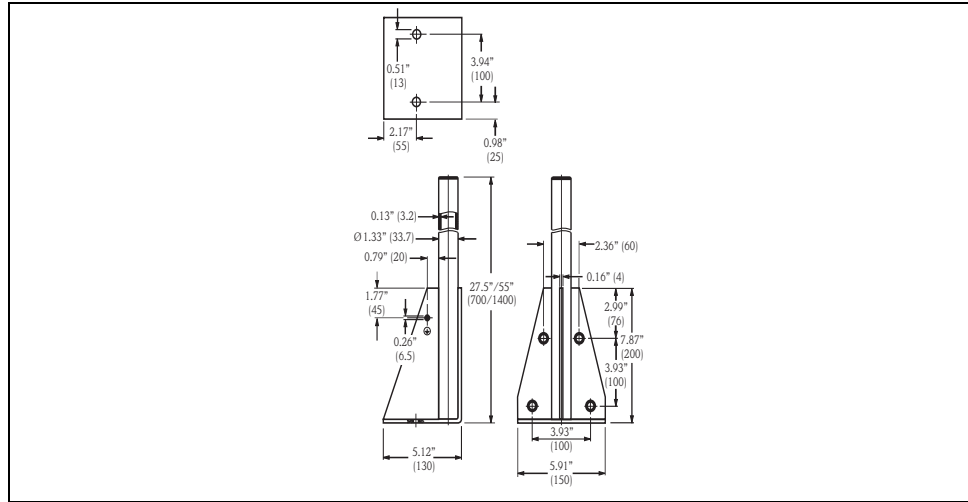

L00-FMU14x-00-00-00-yy-005

Height	Material	Order Code
27.6" (700 mm)	galv. steel	919791-0000
27.6" (700 mm)	1.4301 (AISI 304 SS)	919791-0001
55.1" (1400 mm)	galv. steel	919791-0002
55.1" (1400 mm)	1.4301 (AISI 304 SS)	919791-0003

Wall Bracket

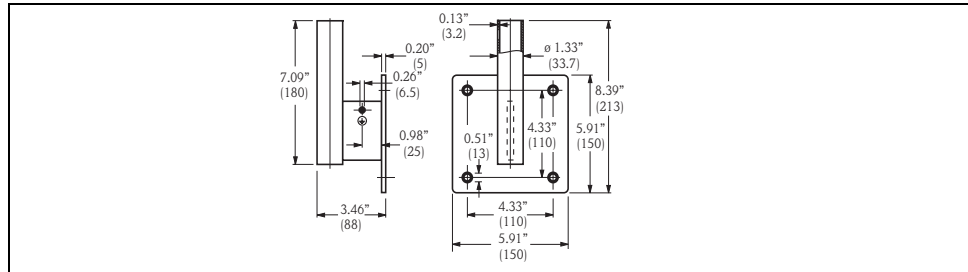


L00-FMU14x-00-00-00-yy-006

Material	Order Code
galv. steel	919792-0000
316Ti SS/1.4571	919792-0001

Alignment unit FAU40

For measurements in solids, usage of the alignment unit FAU40 is recommended. It is designed for simple mounting and alignment of a FDU sensor on the product surface and can be used for zone separation in explosion hazardous areas.

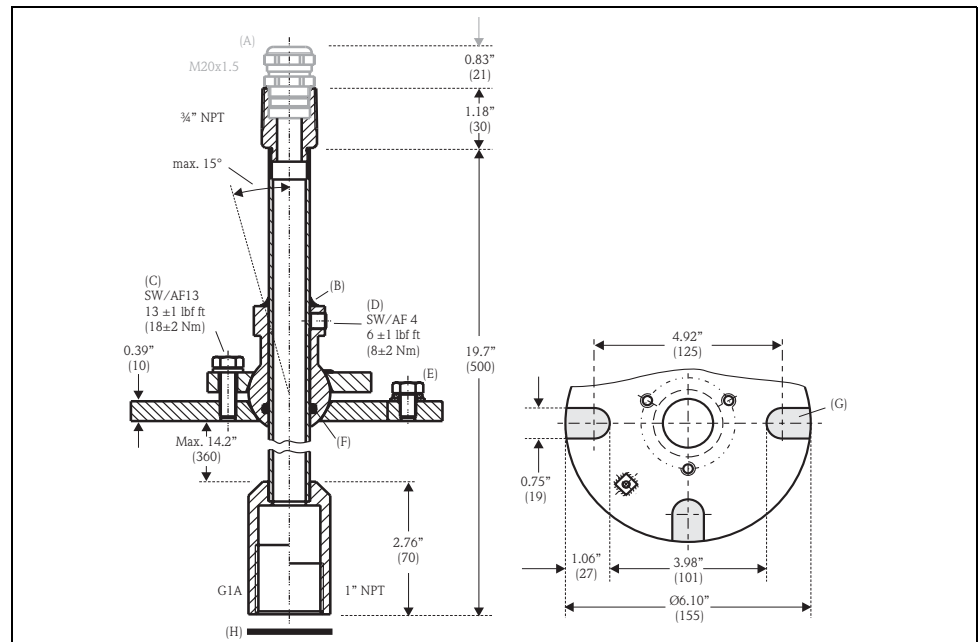

(A): Cable gland M20x1.5 (present if selected in the product structure); (B): sealant here; (C): screw for lateral movement; (D): two Allen screws for height adjustment; (E): ground pin; (F): O-ring; (G): mounting grooves (present in the UNI flange); (H): seal supplied with the sensor; must be used for applications in ATEX zone 20

The alignment unit can be rotated up to 15°. For further information see Technical Information TI 179F.

Product structure

010	Process connection (Flange)
1	Welding flange, 304/1.4301
2	UNI flange 2"/DN50/50A, 304, max. 1.5 bar abs./22psia suitable for 2" 150lbs / DN50 PN16 / 10K 50A
020	Sensor connection
S	Thread G1, cable gland M20, 304/1.4301
G	Thread G1, cable gland M20, galvanised steel
N	Thread NPT1, cable entry 3/4, galvanised steel
FAU40 -	product designation

Supplementary documentation

Innovation booklet

IN 003: Ultrasonic measurement - the solution for your application

Technical Information

TI 397F: Technical Information for the transmitter Prosonic S FMU90
 TI 179F: Technical Information for the alignment unit FAU40

Operating instructions (for transmitter FMU90)

Depending on the instrument version, the following operating instructions are supplied with the Prosonic S FMU90:

Operating instructions	Output	Application	Instrument version
BA 288F	HART	<ul style="list-style-type: none"> ■ level measurement ■ alternating pump control ■ screen and rake control 	FMU90 - *****1**** FMU90 - *****2****
BA 289F		<ul style="list-style-type: none"> ■ flow measurement ■ backwater and dirt detection ■ totalizers and counters 	FMU90 - *2*****1**** FMU90 - *4*****1**** FMU90 - *2*****2**** FMU90 - *4*****2****
BA 292F	PROFIBUS DP	<ul style="list-style-type: none"> ■ level measurement ■ alternating pump control ■ screen and rake control 	FMU90 - *****3****
BA 293F		<ul style="list-style-type: none"> ■ flow measurement ■ backwater and dirt detection ■ totalizers and counters 	FMU90 - *2*****3**** FMU90 - *4*****3****

These operating instructions describe installation and commissioning of the respective version of the Prosonic S. It contains those functions from the operating menu, which are required for a standard measuring task. Additional functions are contained in the "Description of Instrument Functions" (BA 290F, see below).

Description of Instrument Functions (for transmitter FMU90)

BA290F

contains a detailed description of **all** functions of the Prosonic S and is valid for all instrument versions. A PDF file of this document can be found

- on the CD-ROM of the "ToF-Tool - FieldTool Package", which is supplied together with the instrument
- in the internet at "www.endress.com"

Safety Instructions

The following Safety Instructions are supplied with ATEX-certified versions of the sensors. If the sensors are used in hazardous areas, comply with all the specifications in these Safety Instructions.

Sensor version	Certificate	Safety Instructions
<ul style="list-style-type: none"> ■ FDU91 - J**** ■ FDU92 - J**** 	ATEX II 2 G Ex ma II T6 - T1	XA 321F
<ul style="list-style-type: none"> ■ FDU91 - E**** ■ FDU92 - E**** ■ FDU93 - J**** ■ FDU95 - J**** ■ FDU96 - J**** 	<ul style="list-style-type: none"> ■ ATEX II 2 G Ex ma II T6 - T1 ■ ATEX II 1/2 D 	XA322F
<ul style="list-style-type: none"> ■ FDU93 - E**** ■ FDU95 - E**** ■ FDU96 - E**** ■ FDU96 - F**** 	ATEX II 1/2 D	XA323F

United States

Endress+Hauser, Inc.
2350 Endress Place
Greenwood, IN 46143
Tel. 317-535-7138
Sales 888-ENDRESS
Service 800-642-8737
fax 317-535-8498
inquiry@us.endress.com
www.us.endress.com

Canada

Endress+Hauser Canada
1075 Sutton Drive
Burlington, ON L7L 5Z8
Tel. 905-681-9292
800-668-3199
Fax 905-681-9444
info@ca.endress.com
www.ca.endress.com

Mexico

Endress+Hauser, México, S.A. de C.V.
Fernando Montes de Oca 21 Edificio A Piso 3
Fracc. Industrial San Nicolás
54030. Tlalnepantla de Baz
Estado de México
Tel: +52 55 5321 2080
Fax +52 55 5321 2099
eh.mexico@mx.endress.com
www.mx.endress.com